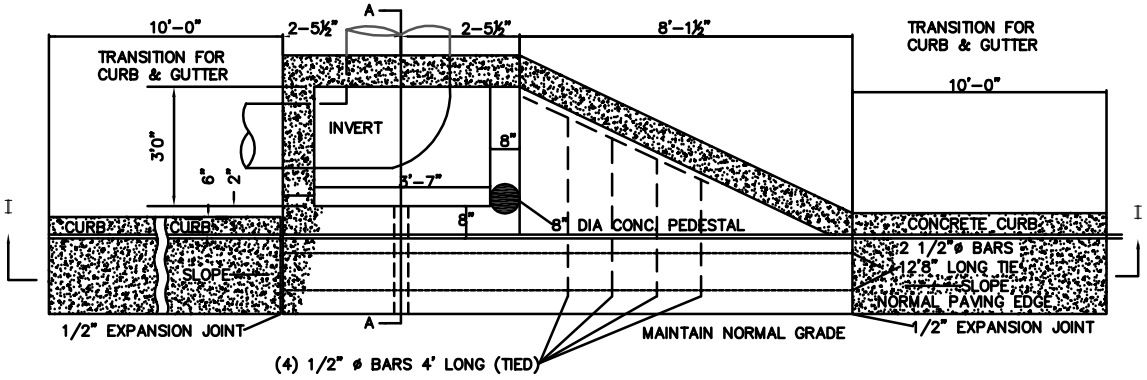

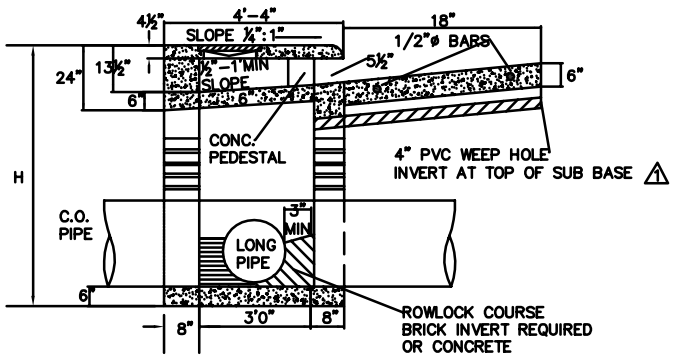

SECTION A-A
CLASS "A" 3000 PSI CONCRETE
N.T.S.

TOP OMITTED FOR CLARITY

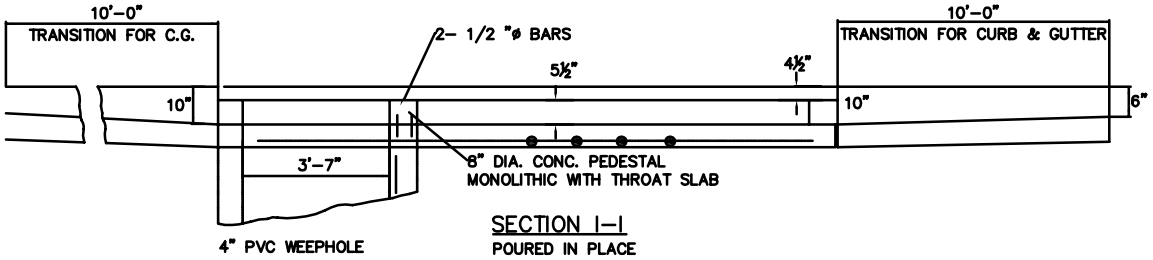

SECTION I-I
POURED IN PLACE
N.T.S.

NOTE:
FOR ALL CATCH BASINS ½" EXPANSION JOINT MATERIAL SHALL BE PLACED AROUND THE CATCH BASIN WHERE SIDEWALK OR MEDIAN PAVEMENT IS PLACED ADJACENT TO THE CATCH BASIN

INSIDE DIAMETER OF PIPE IN INCHES	MINIMUM H
18"	4'-10"
24"	5'-6"
30"	6'-2"

⚠2 D.O.T. STANDARD #1033D IS ALLOWABLE ALTERNATIVE

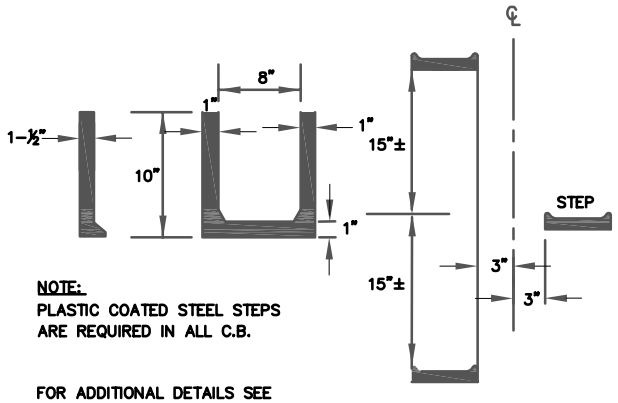

NOTE:
PLASTIC COATED STEEL STEPS ARE REQUIRED IN ALL C.B.

FOR ADDITIONAL DETAILS SEE STANDARD #104

ARRANGEMENT OF STEPS

FULTON COUNTY STANDARD DETAIL 504
SINGLE WING ON LINE CATCH BASIN (BRICK)

DATE	REVISIONS	DATE	REVISIONS
8/09	RC		

DGS/DRN/CHKD: CMS
APPROVED: REW
DATE: 12-2-05

FULTON COUNTY

FULTON COUNTY PUBLIC WORKS
141 PRYOR ST. ATLANTA, GA. 30303
404-612-7400 FAX: 404-224-0978

DRAWING NO. 504